

REGIONAL DISTRICT OF NANAIMO

Water Service Area Annual Report 2012



Nanoose Bay Peninsula Water System

June 2013

REGIONAL DISTRICT OF NANAIMO

Water & Utility Services Department

6300 Hammond Bay Rd, Nanaimo, BC Canada V9T 6N2 | Ph 250-390-6560 | Fax 250-390-1542



Table of Contents

1.	Introduction.....	1
2.	Nanoose Bay Peninsula Water System.....	1
2.1	Groundwater Wells.....	1
2.2	Reservoirs	2
2.3	Distribution System.....	2
3.	Water Sampling and Testing Program.....	3
4.	Water Quality - Source Water and Distribution System	3
5.	Water Quality Inquiries and Complaints	3
6.	Groundwater Production and Consumption.....	3
7.	Maintenance Program.....	5
8.	Water System Projects	5
8.1	2012 Completed Studies & Projects	5
8.2	2013 Proposed Projects & Upgrades	5
9.	Emergency Response Plan.....	6
10.	Cross Connection Control.....	6
11.	Closing	6

Appendix A - Map of Nanoose Bay Peninsula Water Service Area

Appendix B - Water Quality Testing Results

Appendix C - Emergency Response Plan

1. Introduction

The following annual report describes the Nanoose Bay Peninsula (NBP) Water Service Area and summarizes the water quality and production data from 2012. This report also includes a summary of inquiries and complaints, completed and proposed maintenance activities, the Emergency Response Plan, and the Cross Connection Control Program.

This report is to be submitted to the Vancouver Island Health Authority by the Spring of 2013.

2. Nanoose Bay Peninsula Water System

The Nanoose Bay Peninsula Water System was established in 2005 by amalgamating the water service areas locally known as Madrona, Wall Beach, Driftwood, Nanoose (Beachcomber), Fairwinds, Arbutus Park, and West Bay. The previous service areas, if referred to in this report, are noted as neighbourhoods within the NBP service area. In 2012, the Nanoose Peninsula Water System was comprised of 2052 water service customers.

The water supply originates from 11 groundwater wells located in the area, and is supplemented seasonally (as required) with water from the Englishman River. The water supply is chlorinated and stored in several reservoirs throughout Nanoose Bay. A portable back-up generator is available in the event of a power outage. A map of the Nanoose Bay Peninsula Water Service Area is provided in Appendix A for reference.

2.1 Groundwater Wells

Eleven groundwater production wells are located in Nanoose Bay for water supply.

Well / Name	Well Depth	Wellhead Protection In Place	Treated/Untreated with Chlorine
Wallbrook #1	16.9 m	Yes	Treated
Madrona #4	52.1 m	Yes	Un-treated
Madrona #8	17.1m	Yes	Treated
Nanoose #2	53.3 m	Yes	Treated
Nanoose #3	52.7 m	Yes	Treated
Nanoose #4	59.1 m	Yes	Treated
Nanoose #6	107.0 m	Yes	Treated
Fairwinds #1	69.8 m	Yes	Treated
Fairwinds #2	75.3 m	Yes	Treated
Fairwinds #3	72.2 m	Yes	Treated
West Bay #3	75.6 m	Yes	Treated

2.2 Reservoirs

Seven water storage reservoirs are present in the Nanoose Bay Peninsula Water System as follows;

- Madrona (concrete) - 485 m³ (100,000 imperial gallons) capacity
- Beachcomber (steel) - 591 m³ (130,000 imperial gallons) capacity
- Eagle Heights (concrete) - 341 m³ (75,000 imperial gallons) capacity
- Dolphin (steel) - 455 m³ (100,000 imperial gallons) capacity
- Fairwinds Res #1 (concrete) - 701 m³ (154,000 imperial gallons) capacity
- Fairwinds Res #2 (concrete) - 701 m³ (154,000 imperial gallons) capacity
- Arbutus Park (concrete) - 568 m³ (125, 000 imperial gallons) capacity

2.3 Distribution System

The water distribution system in Nanoose Bay is summarized in the table below. Fire hydrants (287) are located throughout the water service area.

Watermain Material	Length of mains in NBP Water Service Area	Prevalence in Water Service Area
<u>Asbestos-concrete:</u> 150mm or smaller 200mm or larger	10.4 km 2.7 km	13.1% 3.4%
<u>PVC:</u> 150mm or smaller 200mm or larger	22.4 km 33.5 km	28.2% 42.1%
<u>Ductile Iron:</u> 150mm or smaller 200mm or larger	0.2 km 10.3 km	0.2% 13.0%

Note: 'PVC' is poly-vinylchloride (plastic)

Photo of Fairwinds Reservoir No. 1



3. Water Sampling and Testing Program

Water sampling and testing is carried out weekly in the distribution system. The following table includes a summary of all testing:

Timing	Location	Tests
Weekly	RDN (in-house) Laboratory	Total coliforms, E.Coli Temperature, pH, Conductivity, Turbidity Chlorine residual, Salinity, TDS
Monthly (Health Dept.)	BC Centre for Disease Control	Total coliforms, E.Coli
Monthly	RDN (in-house) Laboratory	Total Iron and Manganese
Annual Source Water Testing (every Fall)	North Island Labs	Complete potability testing of all raw well water, including T-Ammonia
Annual System Water Testing (every Spring)	North Island Labs	Complete potability testing of distribution system, including T-Ammonia
Temporary Extra Testing Once per month	North Island Labs	True colour, Ammonia, Iron, Manganese, and Chloramines in distribution system

4. Water Quality - Source Water and Distribution System

Up-to-date water quality reports and lab data are posted monthly on the RDN website at www.rdn.bc.ca in the SERVICES section, under “Water Services” then “WaterSmart Communities”. Tables of water quality testing results for both the source water and distribution system are provided at the end of this report under Appendix B.

In 2012, construction of a drinking water filtration plant was completed at 2480 Nanoose Road. This filtration plant has been in operation since November 2011, and it’s purpose is to filter out iron and manganese particulate from the groundwater pumped from Fairwinds Wells #1, 2, and 3, and the West Bay Well #3.



5. Water Quality Inquiries and Complaints

Numerous inquiries were received from the Nanoose Bay water service area in 2012 and were typically related to when the filtration plant would be completed. After the treatment plant was in operation, several additional inquiries were received regarding the water hardness and whether in-home water softeners would still be required.

While the water hardness is not being treated at the water filtration plant, the tap water quality has improved. Filtered groundwater from the Fairwinds and West Bay wells is mixed with raw well water from the other Nanoose wells (when required), and stored in the same seven reservoirs throughout Nanoose Bay. The most notable improvement to the tap water is the reduced appearance of iron and manganese minerals (reddish-brown particulate).

6. Groundwater Production and Consumption

The monthly groundwater well production and bulk water flows for the past 5 years are shown in the charts below. Groundwater production and bulk water flows in 2012 were low to average in comparison to previous years.

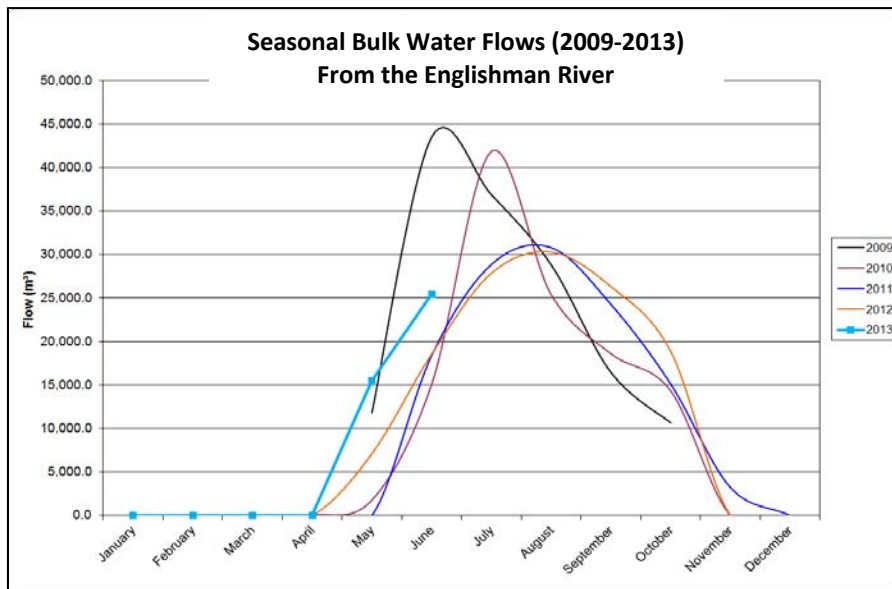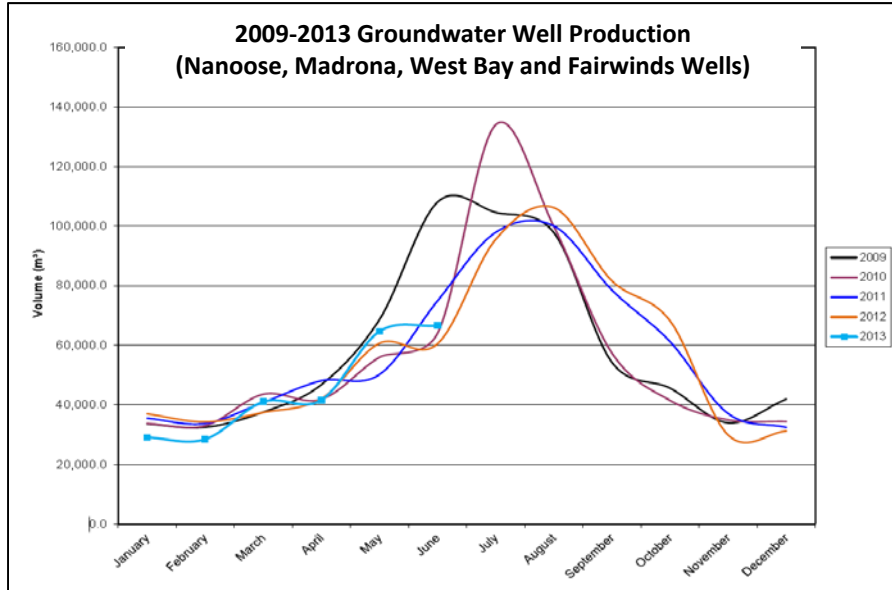

In the Fall/Winter of 2012, the average usage per home in Nanoose Bay was 0.38 cubic metres per day (84 imperial gallons). In the summer, the average water usage was 1.15 cubic metres per day (253 imperial gallons). Based on these figures, the annual consumption per capita is estimated to be 267 L/day (based on 2.4 people/household). This consumption is similar to the RDN system average of 268 L/day/capita in 2012.

7. Maintenance Program

Weekly pump station inspections are carried out to reduce or eliminate the risk of contamination and system failure, and to ensure the consistent application of chlorine for treatment purposes. Watermains are flushed once annually in the Spring. In the Fairwinds neighbourhood the watermains are flushed a second time in the Fall. Fire hydrants are serviced once per year (either 'A-level' or 'B-level' maintenance). Water storage reservoirs are drained and cleaned once every two years. Twenty-four hour on-call coverage is in place to respond to water system emergencies and alarms.

8. Water System Projects

8.1 2012 Completed Studies & Projects

- Completed construction of the Nanoose Bay Water Treatment (filtration) Plant;
- Completed well automation and well upgrades associated with water filtration plant requirements;
- Constructed a new ladder for the Dolphin Beach reservoir (to be installed 2013);
- Completed annual fire hydrant maintenance;
- Replaced several watermain flushouts;
- Drained and cleaned the Beachcomber, Eagle Heights, Dolphin, Fairwinds #1, Fairwinds #2, and Arbutus Park water storage reservoirs;
- Installed additional dedicated water sampling locations;
- Completed Cross Connection Control wording in the water supply bylaw;
- Reviewed the Development Cost Charge and Capital Charge fee structures;
- Expanded and updated the Standard Operating Procedures;
- Enforced the outdoor sprinkling regulations;
- Carried out a comprehensive water conservation campaign (Team WaterSmart);
- Updated and improved the RDN website at www.rdn.bc.ca;
- Updated the Emergency Response Plan;
- Utilized the Auto E-message service to notify member residents of water service disruptions and upcoming maintenance activities;
- Applied a low-flush toilet incentive;
- Applied a rainwater harvesting incentive (rain barrels);
- Maintained excellent customer complaint and service request response times;
- Continued quality control through regular testing and monitoring of our water systems; and
- Completed additional educational programs.

8.2 2013 Proposed Projects & Upgrades

- Drain and clean the Fairwinds #1 (again) and Madrona water storage reservoirs;
- Install the new Dolphin Beach reservoir access ladder;
- Paint the Beachcomber reservoir;
- Update Standard Operating Procedures; and
- Continue to offer a low-flush toilet and rainwater harvesting (rain barrel) incentive.

9. Emergency Response Plan

The Regional District has an Emergency Response Plan (ERP) that contains procedures and contact information to efficiently respond to water system emergencies such as contamination of water supply, loss of supply, and pump failure. The ERP was reviewed and updated in 2012, and copies are available on our website, at each RDN office, in each pumphouse, and in each Water Services vehicle. A copy of the ERP is also attached to this report in Appendix C.

10. Cross Connection Control

A formalized Cross Connection Control Program was initiated in 2007. Cross connection controls in-place include dual check valves at each service connection, fire hydrant use permits, and water supply bylaws noting discontinued service if a threat to the water supply is perceived by staff.

In 2008, a review and comparison of successful cross-connection control programs in other small water systems nearby was undertaken. A database of commercial customers was set-up in order to keep track of the maintenance history of testable backflow prevention assemblies at each site. Three RDN Operations staff achieved Backflow Prevention Tester’s certification.

In 2012, *Regional District of Nanaimo Water Use Regulation Bylaw No. 1654, 2012* was adopted which includes enhanced cross connection control and backflow protection wording. A separate Cross Connection Control bylaw was deemed not to be required.

11. Closing

An annual report for the year 2013 will be prepared and submitted to the Vancouver Island Health Authority in the Spring of 2013. Annual reports are also available on our website at www.rdn.bc.ca in the SERVICES section, under “Water Services” then “WaterSmart Communities”.



**Completed Water
Filtration Plant**


**Filtration chambers
shown**

APPENDIX A

MAP OF NANOOSE BAY PENINSULA

WATER SERVICE AREA

NANOOSE BAY PENINSULA WATER SERVICE AREA

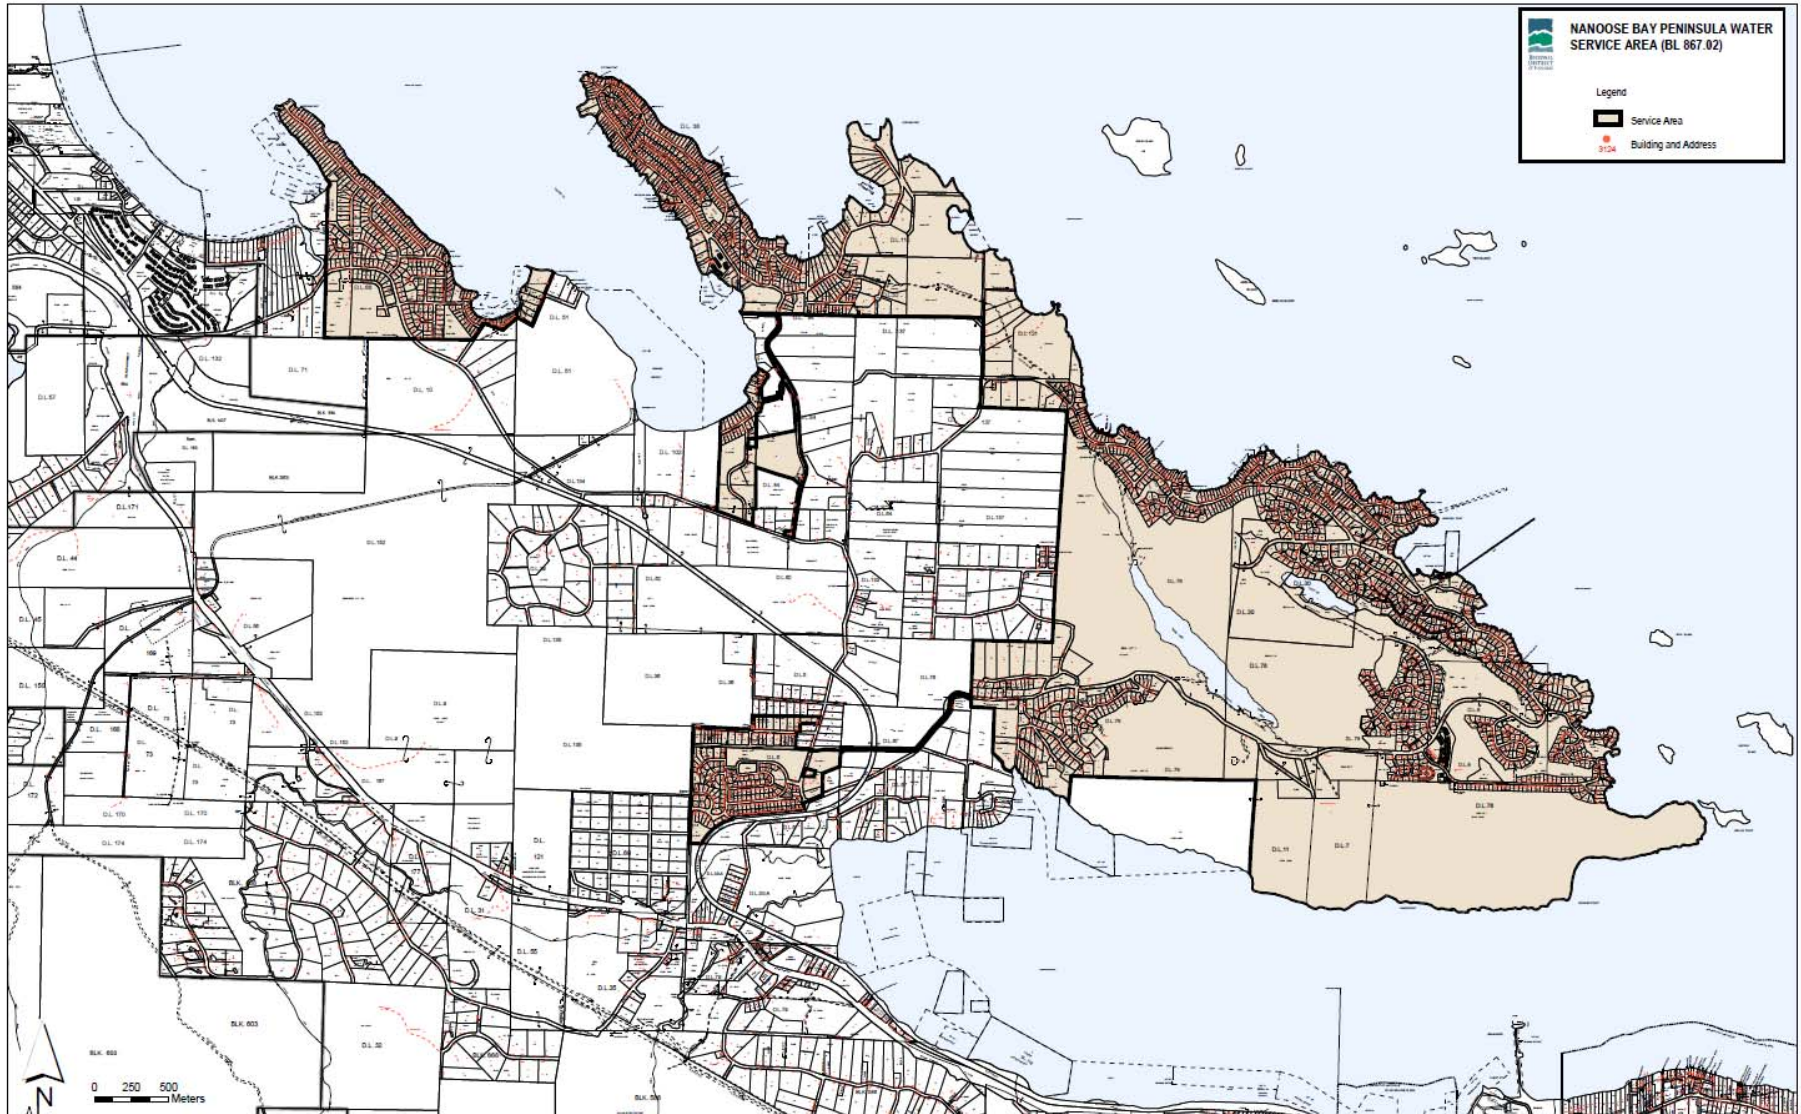

APPENDIX B

WATER QUALITY TESTING RESULTS